

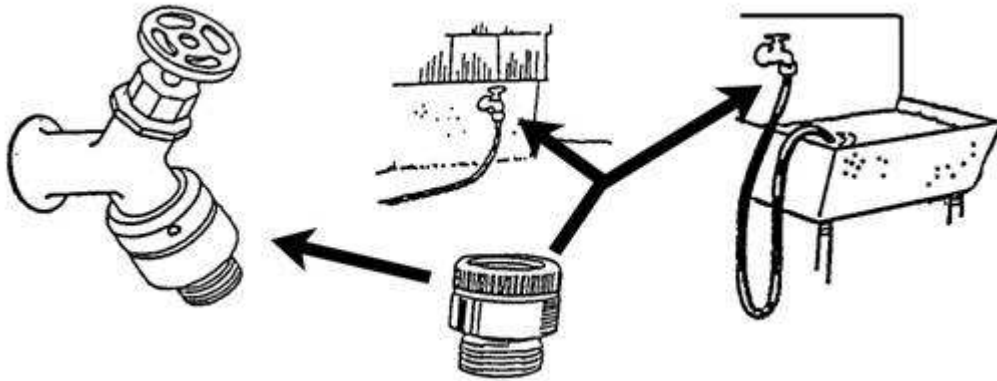



BACKFLOW PREVENTION IS REQUIRED

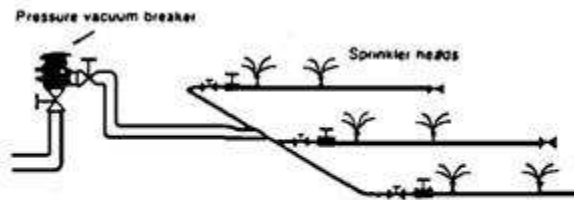


**HOSE CONNECTION VACUUM BREAKER
A.S.S.E. STANDARD 1011
TYPICAL APPLICATION: THREADED HOSE OUTLETS**



**INSTALLATION RESTRICTIONS REQUIRE THIS DEVICE TO BE
12" HIGHER THAN THE HIGHEST SPRINKLER HEAD IN THE SYSTEM**

**PRESSURE TYPE VACUUM BREAKER
A.S.S.E. STANDARD 1020
TYPICAL APPLICATION: IRRIGATION SYSTEMS**

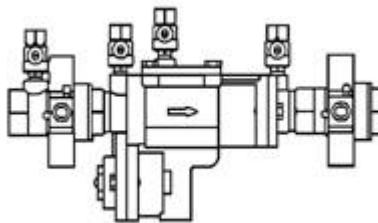

**REDUCED PRESSURE ZONE BACKFLOW PREVENTER
A.S.S.E. STANDARD 1013
TYPICAL APPLICATION: WATER BACK-UP SUMP PUMP SYSTEM AND IRRIGATION SYSTEMS**

**BACKFLOW DEVICES MUST BE STAMPED WITH THE
AMERICAN SOCIETY OF SANITARY ENGINEERING SEAL (A.S.S.E.)**

**ALL BACKFLOW PREVENTION DEVICES HAVE INSTALLATION, MAINTENANCE AND TESTING
REQUIREMENTS. SHOULD YOU HAVE ANY QUESTIONS OR DOUBTS, PLEASE CALL THE CROSS
CONNECTION INSPECTOR AT 586-286-9300**